

## CURB CUT / DRIVEWAY PERMIT

NAME: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

PHONE NUMBER: \_\_\_\_\_

LOT: \_\_\_\_\_ BLOCK: \_\_\_\_\_ ADDITION: \_\_\_\_\_

LEGAL DESCRIPTION (if unplotted): \_\_\_\_\_

WIDTH OF DRIVEWAY/WIDTH BETWEEN CUTS: \_\_\_\_\_

APPROXIMATE DATE WORK IS TO BE PERFORMED: \_\_\_\_\_

\_\_\_\_\_  
APPLICANT'S SIGNATURE

All work must be done in accordance with the attached details.  
Form work and saw cuts must be inspected prior to placing concrete.  
Please call the Building Inspections Department at 246-2572 to schedule an inspection.

BELOW LINE FOR CITY USE ONLY:

COMMENTS: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

DATE OF ISSUANCE: \_\_\_\_\_ ISSUED BY: \_\_\_\_\_


WORK HAS BEEN COMPLETED TO THE CITY'S SATISFACTION.

THE FOLLOWING CORRECTIONS ARE NECESSARY:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

INSPECTOR: \_\_\_\_\_ DATE: \_\_\_\_\_

FORM \_\_\_\_\_

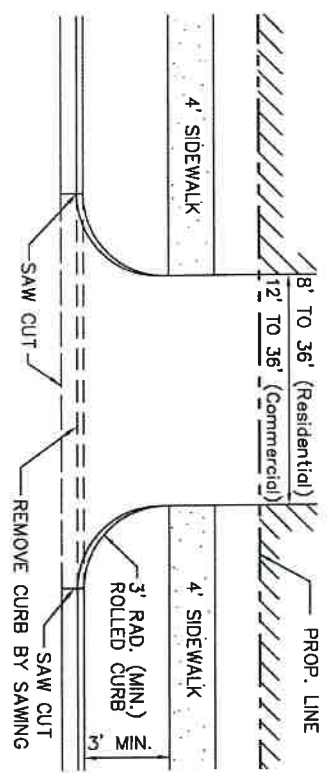


### DRIVEWAY DETAIL

N.T.S.

### DRIVEWAY SECTION

N.T.S.

- Two car garage max 26'. Three car garage max 36'.
- Residential driveways shall be Portland Cement concrete no less than four (4) inches thick.
- Commercial driveways, including sidewalks in drive areas, shall be Portland cement concrete no less than six (6) inches thick.
- Driveways shall be constructed of concrete on a two (2) inch sand cushion. The concrete mix shall provide a 28 day compressive strength of 3000 pounds per square inch.
- Reinforcement equal to or exceeding 6"x 6", 10 gage welded wire mesh shall be provided in driveways.
- All driveway curb returns shall have a minimum radius of three (3) feet.
- The length of the driveway plus six (6) feet.
- The elevation of the driveway at the front of the sidewalk line or at a point no less than three (3) feet from back of curb shall be a minimum of six (6) inches above the flow line of the gutter.
- Call 246-2572 to schedule an inspection prior to placing concrete.
- NO CURB CUTS SHALL BE LEFT OPEN

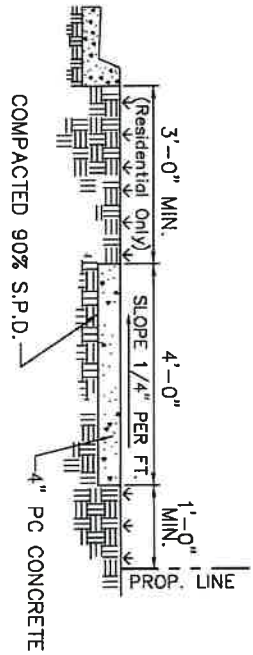

### SIDEWALK DETAIL

N.T.S.

- Sidewalk**  
Residential sidewalks shall be no less than four (4) inches thick and four (4) feet wide and shall be placed a minimum of three (3) feet from the back of the curb.
- Design of sidewalks within commercial or industrial areas will be reviewed and approved by the City Engineer.
- Sidewalks shall be constructed of Portland cement concrete on a two (2) inch sand cushion. The concrete mix shall provide a 28 day compressive strength of 3000 pounds per square inch. Expansion joints shall be placed at 20' intervals. Redwood or 3/4" premoistened expansion material shall be provided at expansion joints.
- Sidewalks must be placed flat, with no abrupt transitions and must have a "BROOM" finish.
- Call 246-2572 to schedule an inspection prior to placing concrete.

<b>DRIVEWAY &amp; SIDEWALK DETAILS</b>			
CITY OF SAND SPRINGS, OKLAHOMA			
CITY OF SAND SPRINGS P.O. BOX 338 SAND SPRINGS, OK. 74053 (918) 246-2500			
PLAN SCALE	DRAWN	VLM	APPROVED
Not To Scale	DESIGN	LWB	
DATE: March 2014		SHEET 1 OF 1	